




CITY OF LODI

PUBLIC WORKS DEPARTMENT

DOMESTIC WATER SERVICE

(3", 4", 6" & 8")

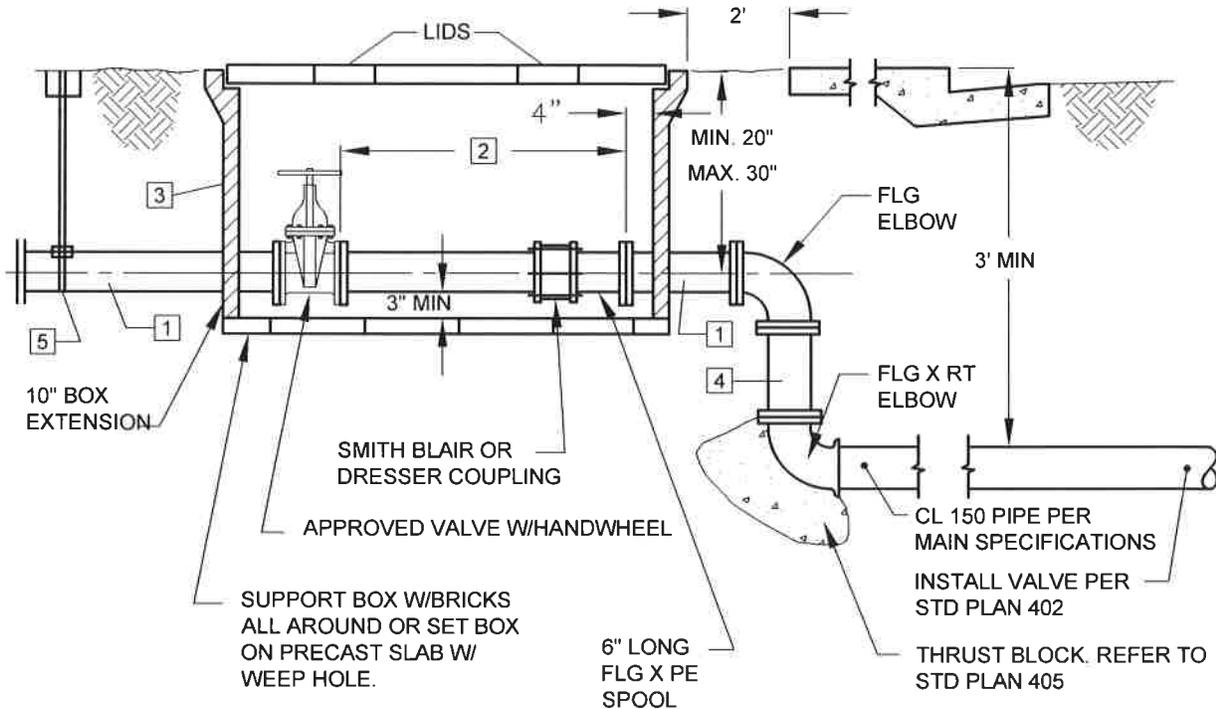

NOTES:

1. METER (IF REQUIRED) WILL BE FURNISHED AND INSTALLED BY CITY.
2. BYPASS MAY BE INSTALLED WITH THE SPECIFIC APPROVAL OF THE PUBLIC WORKS DIRECTOR.
3. PLUG ALL OPENINGS IN BOX.
4. BACKFILL SHALL CONFORM TO STD PLAN 501.
5. ALL FITTINGS MUST COMPLY WITH THE LATEST STATE OF CALIFORNIA NO LEAD REQUIREMENTS.

SHEET 1 OF 2

Dr.	KT	No.	Date	Revision	Appr.	Approved By:	STD PLAN
Ch.	WS	1	2/05	REVISED SPOOL LENGTH'S			406
Date	12/00					6/26/19 Date	

Lyman Chang
City Engineer
RCE No. 53149



CITY OF LODI

PUBLIC WORKS DEPARTMENT

DOMESTIC WATER SERVICE (3", 4", 6" & 8") MATERIALS LIST

- 1 FLG SPOOL, 24" LONG (2 EA) (C.I., D.I., OR STEEL)
- 2 FLG X PLAIN END SPOOL. LEAVE 1" GAP AT COUPLING
 - 3" - 29" LONG
 - 4" - 38" LONG ENDS OF SPOOLS
 - 6" - 43" LONG (C.I. OR STEEL)


CHRISTY OR BES BOX	LID (TRAFFIC)		BOX EXTENSION
	CHRISTY	BES	
3"+4" B-48 OR C48W	B48-62D	62D85	10" BOX EXTENSION B48 X 10
6" B-52 OR C52W	B52-62D	62D90	10" BOX EXTENSION B52 X 10

- 4 FLG SPOOL, LENGTHS AS NEEDED (OPTIONAL) (C.I., D.I., OR STEEL)
- 5 TEMPORARY BLOWOFF PER STD PLAN 409. 2" FOR 4"-6" SERVICE,
4" FOR 8" AND LARGER SERVICE.

ALL FITTINGS SHALL BE CAST OR DUCTILE IRON OR STEEL (AS NOTED) AND SHALL CONFORM TO APPLICABLE AWWA STANDARDS. (SCH. 40, 150 LB. FLG)

TRAFFIC LIDS SHALL BE USED IN ALL LOCATION.

SHEET 2 OF 2

Dr. KT	No.	Date	Revision	Appr.	Approved By:	 Lyman Chang City Engineer RCE No 53149	6/26/19 Date	STD PLAN
Ch. WS	1	2/05	REVISED SPOOL LENGTH'S					406
Date 10/08	2	10/08	REVISED SPOOL LENGTH'S					