




# CITY OF LODI

PUBLIC WORKS DEPARTMENT


## WATER SAMPLING STATION

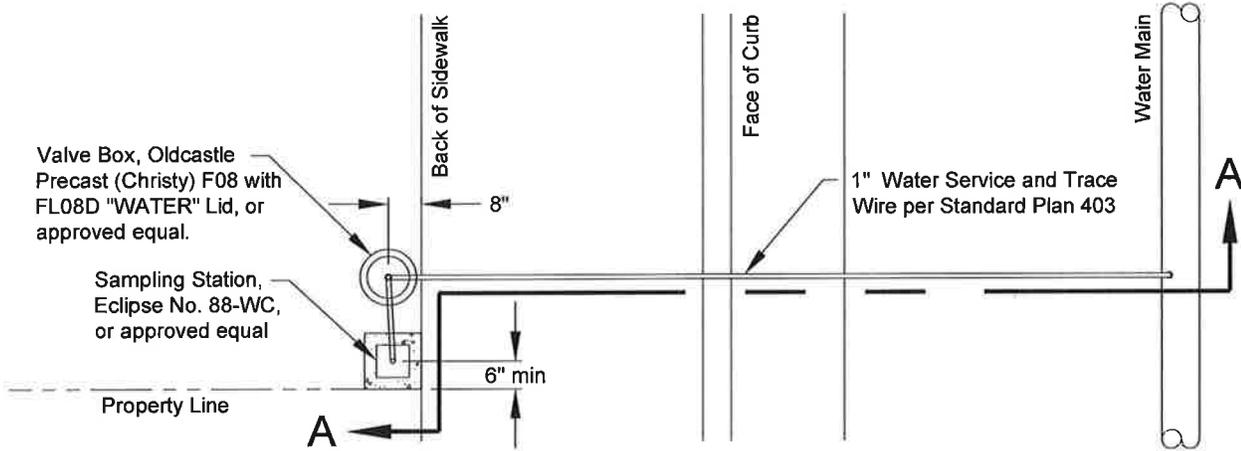

Plan View

**Notes:**

1. Backfill shall conform to Std. Plan 501.
2. All fittings shall comply with California No-Lead brass requirements.
3. Maintain 24" clearance between tap and any coupling, fitting or adjacent tap. Plastic services shall be looped approximately 6" vertically or laterally to provide slack in the line.

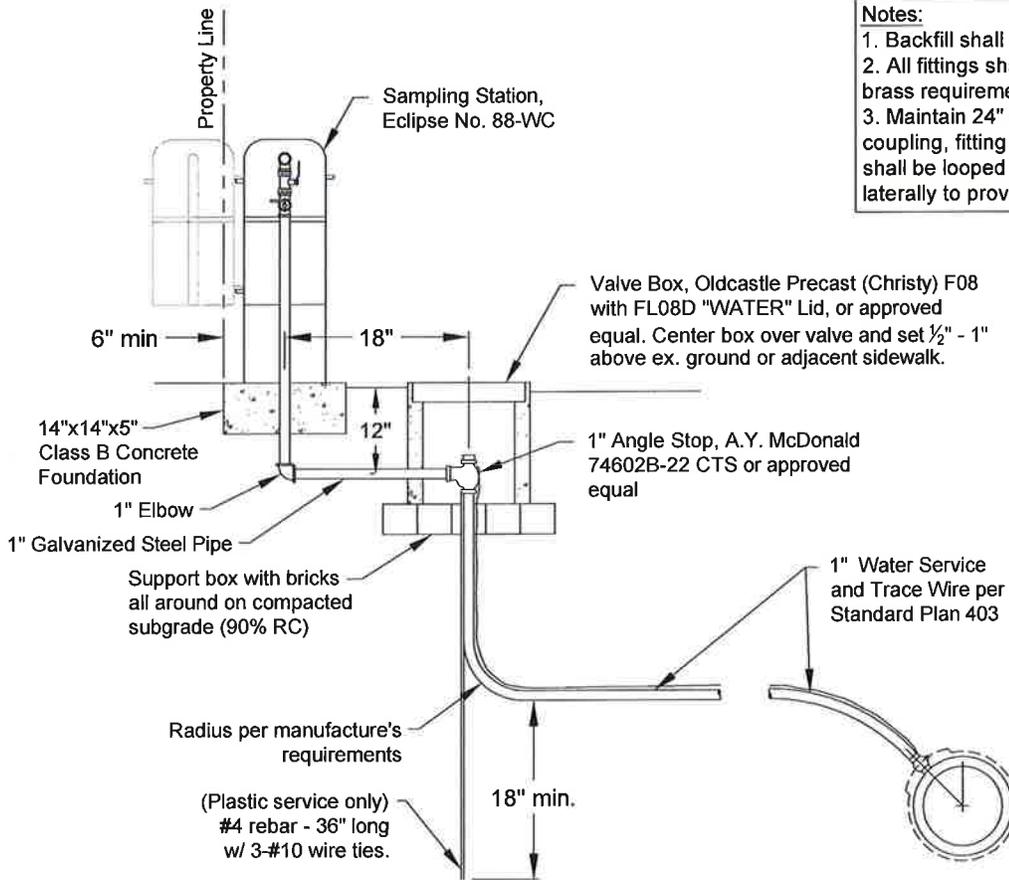

Section A-A

Dr.	SN	No.	Date	Revision	Appr.	Approved By:	STD PLAN
Ch.	LC					<i>Charles Swimley</i>	417
Date	9/13					Charles Swimley Deputy Public Works Director R.C.E. 52842	9.11.13 Date